

# J&I Cleaning Services Post Clean Ventilation Report



**Site Address:**  
Sample 2

**Date of Service:** XXXXXX

## Post Clean Ventilation Report

### Condition of the fan unit? Grade A – D

Grade B  
There was a medium build up of grease covering the fan blades and housing unit.

### Condition of Canopy and Filters? Grade A - D

Grade B  
There was a medium build up of grease covering the canopy, filters and plenum chamber.

### Any obstructions and/or areas that could not be accessed for cleaning?

None noted at the time of service.

### Any damage reported by our operatives?

None reported.

### Any proposed changes to the system for the client?

Consider a grease filter cleaning service.

### Equipment used to clean

By hand using scrapers, scourers and cleaning agents.



**J&I Cleaning Services**

Unit 7,  
Eastcote Industrial Estate,  
Field End Road,  
Eastcote, Middlesex  
HA4 9XG

02088663413

info@jicleaning.com

www.jicleaning.com

## Pre and Post Clean Photographs

### Location – canopy

Wet Film Thickness Test in  $\mu\text{m}$  - 500



Wet Film Thickness Test in  $\mu\text{m}$  - 0



### Location – filters

Wet Film Thickness Test in  $\mu\text{m}$  - 500



Wet Film Thickness Test in  $\mu\text{m}$  - 0




### Location – canopy

Wet Film Thickness Test in  $\mu\text{m}$  - 500




Wet Film Thickness Test in  $\mu\text{m}$  - 0

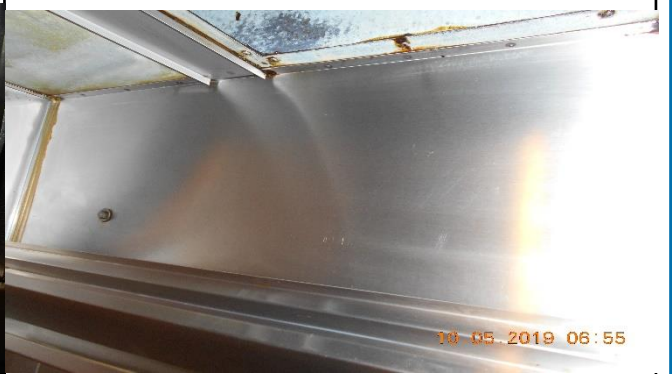

Pre and Post Clean Photographs

**Location – upstream of the fan unit**

Wet Film Thickness Test in  $\mu\text{m}$  - 750

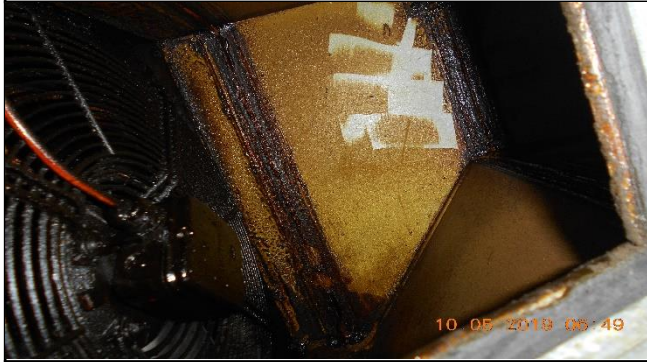

Wet Film Thickness Test in  $\mu\text{m}$  - 0



**Location – upstream of the fan unit**

Wet Film Thickness Test in  $\mu\text{m}$  - 750



Wet Film Thickness Test in  $\mu\text{m}$  - 0




**Location – exhaust point**

Wet Film Thickness Test in  $\mu\text{m}$  - 550



Wet Film Thickness Test in  $\mu\text{m}$  - 0

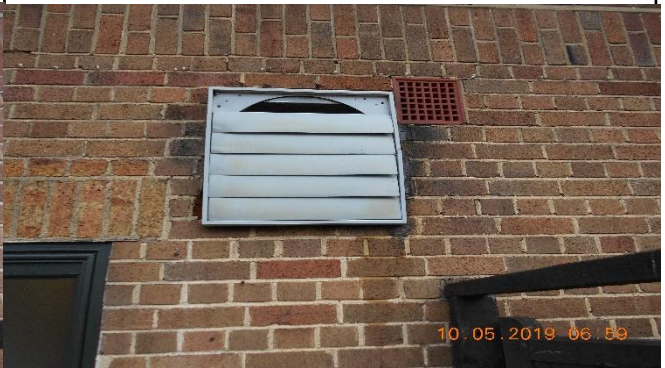

## Pre and Post Clean Photographs

**Location – fan unit downstream**

Wet Film Thickness Test in  $\mu\text{m}$  - 550



Wet Film Thickness Test in  $\mu\text{m}$  - 0



Additional WFT test location(s) with significant grease accumulation (If required)	WFT in $\mu\text{m}$ -
n/a	-
n/a	-
n/a	-

**Any Access Panels Fitted? Amount, Type and Size**

None Fitted.

1. Were any issues highlighted to the client or security on site? No  
If yes, who did you inform?
2. Was the time of the service suitable? YES  
If no, why not?
3. If required, was maintenance available on site? NO – not required


**FREQUENCY OF CLEANING**

Perceived level of grease production	Typical example	Suggested Cleaning Intervals (months)			
		Daily usage			
		Up to 6 hours	6-12 hours	12-16 hours	16+ hours
Low	No significant production of grease laden aerosols during normal daily food production operations.	12	12	6	6
Medium	Moderate production of grease laden aerosols during normal daily food production operations.	12	6	4	3
High	Heavy, significant or continual production of grease laden aerosols during normal daily food production operations.	6	3	3	2

**LEGAL NOTICE**








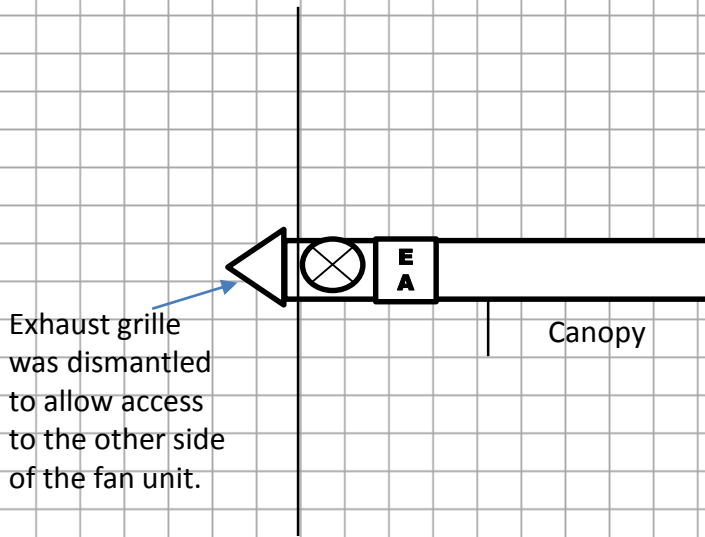













If J&I Cleaning Services Ltd. are unable to perform the services in accordance with the Specification due to accessibility problems for any reason, J&I Cleaning Services Ltd. will bring this to the Customer's attention whilst highlighting any significant deficiencies in hygiene and cleaning in this ventilation cleaning report. It is the customer's responsibility to arrange suitable access to the ventilation system. J&I Cleaning Services Ltd. shall not be held liable for any costs or losses sustained or incurred by the customer where the customer fails to perform its aforementioned obligation. If accessibility is an issue, J&I Cleaning Services Ltd. holds the right to suspend any services until the customer arranges suitable access and the customer shall indemnify J&I Cleaning Services for any costs or losses sustained or incurred arising from J&I Cleaning Services Ltd. having to revisit the premises at a later date.

Please note this is not to scale.



### Drawing of ventilation system

please include existing access panels and where access panels need to be fitted.

	Duct Work		Damper		Fire Damper
	Circular Duct Work		Silencer		Fire Sensor
	Fan Unit		Inaccessible Duct Work		Atmosphere Point
	Square Duct Heading To Viewer		Air Handling Unit		Inaccessible Duct Heading To Viewer
	Circular Duct Heading To Viewer		Turning Vane		Canopy
	Existing Access		Flexi Hose		Roof/Wall/Ceiling
	New Access – Where blue denotes suggested but not fitted.		Existing access NOT ACCESSIBLE		Replace Door



# Duty of Care Waste Transfer Note

## J&I Cleaning Services Ltd.

<p><b>Section A – Description of Waste</b></p> <p><b>A1</b> Rags which have been used for commercial kitchen cleaning, these are covered with oven cleaner and degreaser detergent. Washing recycles a large majority of rags, only ones that have been heavily coated in grease are disposed of at J&amp;I Cleaning Services Ltd. premises. General waste to include cardboard and plastic containers.</p> <p><b>Waste regulation codes</b> 20 03 01 Mixed Municipal Waste 15 02 03 Absorbents, filter materials, wiping cloths etc.</p>	<p><b>A2</b> Waste is contained in black sacks and some loose waster</p> <p><b>A3</b> How much waste? Most bags with rags will be washed for reuse only the rags and dustsheets that are badly contaminated with kitchen oil &amp; grease will be disposed of</p> <ol style="list-style-type: none"> <li>Are the rags badly contaminated with grease? YES/NO</li> <li>Are you transferring empty chemical containers and negligible quantity of mixed municipal waste? YES/NO</li> <li>Approximately how much waste?</li> </ol>
<p><b>Section B – Transferor</b></p> <p><b>B1</b> J&amp;I Cleaning Services Ltd. Unit 7, Eastcote Industrial Estate, Field End Road, Ruislip, HA4 9XG</p> <p><b>B2</b> Hillingdon Borough Council</p>	<p><b>B3</b> The producer of waste. The holder of an environmental permit N/A Issued by N/A Exempt from requirements to carry waste N/A Registration number N/A Registered Waste Carrier No CBDL219508 Details – Carrier of waste.</p>
<p><b>Section C Transferee</b></p> <p><b>C1</b> J&amp;I Cleaning Services Ltd. Unit 7, Eastcote Industrial Estate, Field End Road, Ruislip, HA4 9XG</p> <p><b>C2</b> Authorised for transport purposes.</p>	<p><b>C3</b> The producer of waste. The holder of an environmental permit N/A Issued by N/A Exempt from requirements to carry waste N/A Registration number N/A Registered Waste Carrier No CBDL219508 Details – Carrier of waste.</p>
<p><b>Section D The Transfer</b></p> <p>Address of site on the report documents</p>	<p>Broker who arranged transfer N/A Times N/A</p>
<p>Transferor’s Signature Tomasz Szanjder</p> <p>Name Tomasz Szanjder</p> <p>Representing J&amp;I Cleaning Services Ltd.</p>	<p>Transferee’s Signature...Same as Transferor</p> <p>Name...Same as Transferor</p> <p>Representing J&amp;I Cleaning Services Ltd.</p>

